


HALGAN 1000 LITRE S SERIES COOLING PIT DETAIL

Notes

1. **Product:**
The Halgan Cooling Pit is used to cool the liquid waste water and provide a discharge to the sewer of not more than 38 o C. The inlet and outlet design provide mixing of the waste water. The Halgan Cooling Pit is manufactured from polyethylene.
2. **Application:**
The Halgan Cooling Pit is used for treatment of waste water from Launderette, Commercial/Industrial laundry and boiler blow down. In some applications where large quantities of hot waste water is discharged, it may be required to install a cooling tower to lower the temperature.
3. **General**
 - 3.1. Tank constructed from Polyethylene.
 - 3.2. The Cooling Pit is to be installed in a location that will not cause a nuisance, obstruct fire access, cannot be vandalised or be damaged by vehicles.
 - 3.3. The Cooling Pit must have ease of access to pumpout point for maintenance.
 - 3.4. A hose tap fitted with RPZD backflow protection (as per AS/NZS 3500) must be installed within 5 metres of the Cooling Pit for maintenance and cleaning.
4. **Installation above ground**
 - 4.1. The Cooling Pit is to be supported on a 100mm thick concrete pad. A stand is available for the Halgan S Series Cooling Pit if required.
 - 4.2. Any maintenance platform must be installed in accordance with Australian Standard 1657-1992 allowing safe access while inspecting and maintaining the Cooling Pit.
 - 4.3. All pipes connecting to the Cooling Pit shall be fully supported, there shall be no stress on the tank connections.
 - 4.4. All stormwater must be diverted away from the Cooling Pit to prevent undermining of foundation.
5. **Installation below ground**
 - 5.1. All connections to the Cooling Pit shall be in accordance with the appropriate authorities.
 - 5.2. Any excavation exceeding 1.5 metres in depth shall comply with the construction safety acts and regulations before backfilling.
 - 5.3. The Cooling Pit must be filled with water prior to backfilling.
6. **Excavation dimensions**
 - 6.1. The excavated hole width shall be kept as narrow as practicable. The depth shall not be greater than 150mm more than the required depth.
 - 6.2. 75mm clearance is required at the sides of tank.
7. **Over excavation**
 - 7.1. Where an excavation has been made deeper than required, the excess depth shall be filled either with bedding material compacted to achieve 98% compaction or concrete.
8. **Water Charged Ground**
 - 8.1. Where installation is in high water table or water charged ground, mine subsidence, filled or unstable areas, the services of a qualified structural engineer is required for certification.
9. **Bedding material**
 - 9.1. The bedding material shall be 1 part Portland cement to 4 parts clean sand.
 - 9.2. The bedding shall be thoroughly compacted by tampering at 300 mm layers.
 - 9.3. The bedding material shall encase the whole tank.
10. **Final Backfill**
 - 10.1. The final backfill material shall comply with the following:
 - 10.1.a. Spoil from the excavation of the trench may be used.
 - 10.1.b. Foreign material such as builder's waste, bricks, and concrete shall not be used.
 - 10.1.c. The backfill shall be compacted to restore the excavated hole as near as practicable to the normal ground.

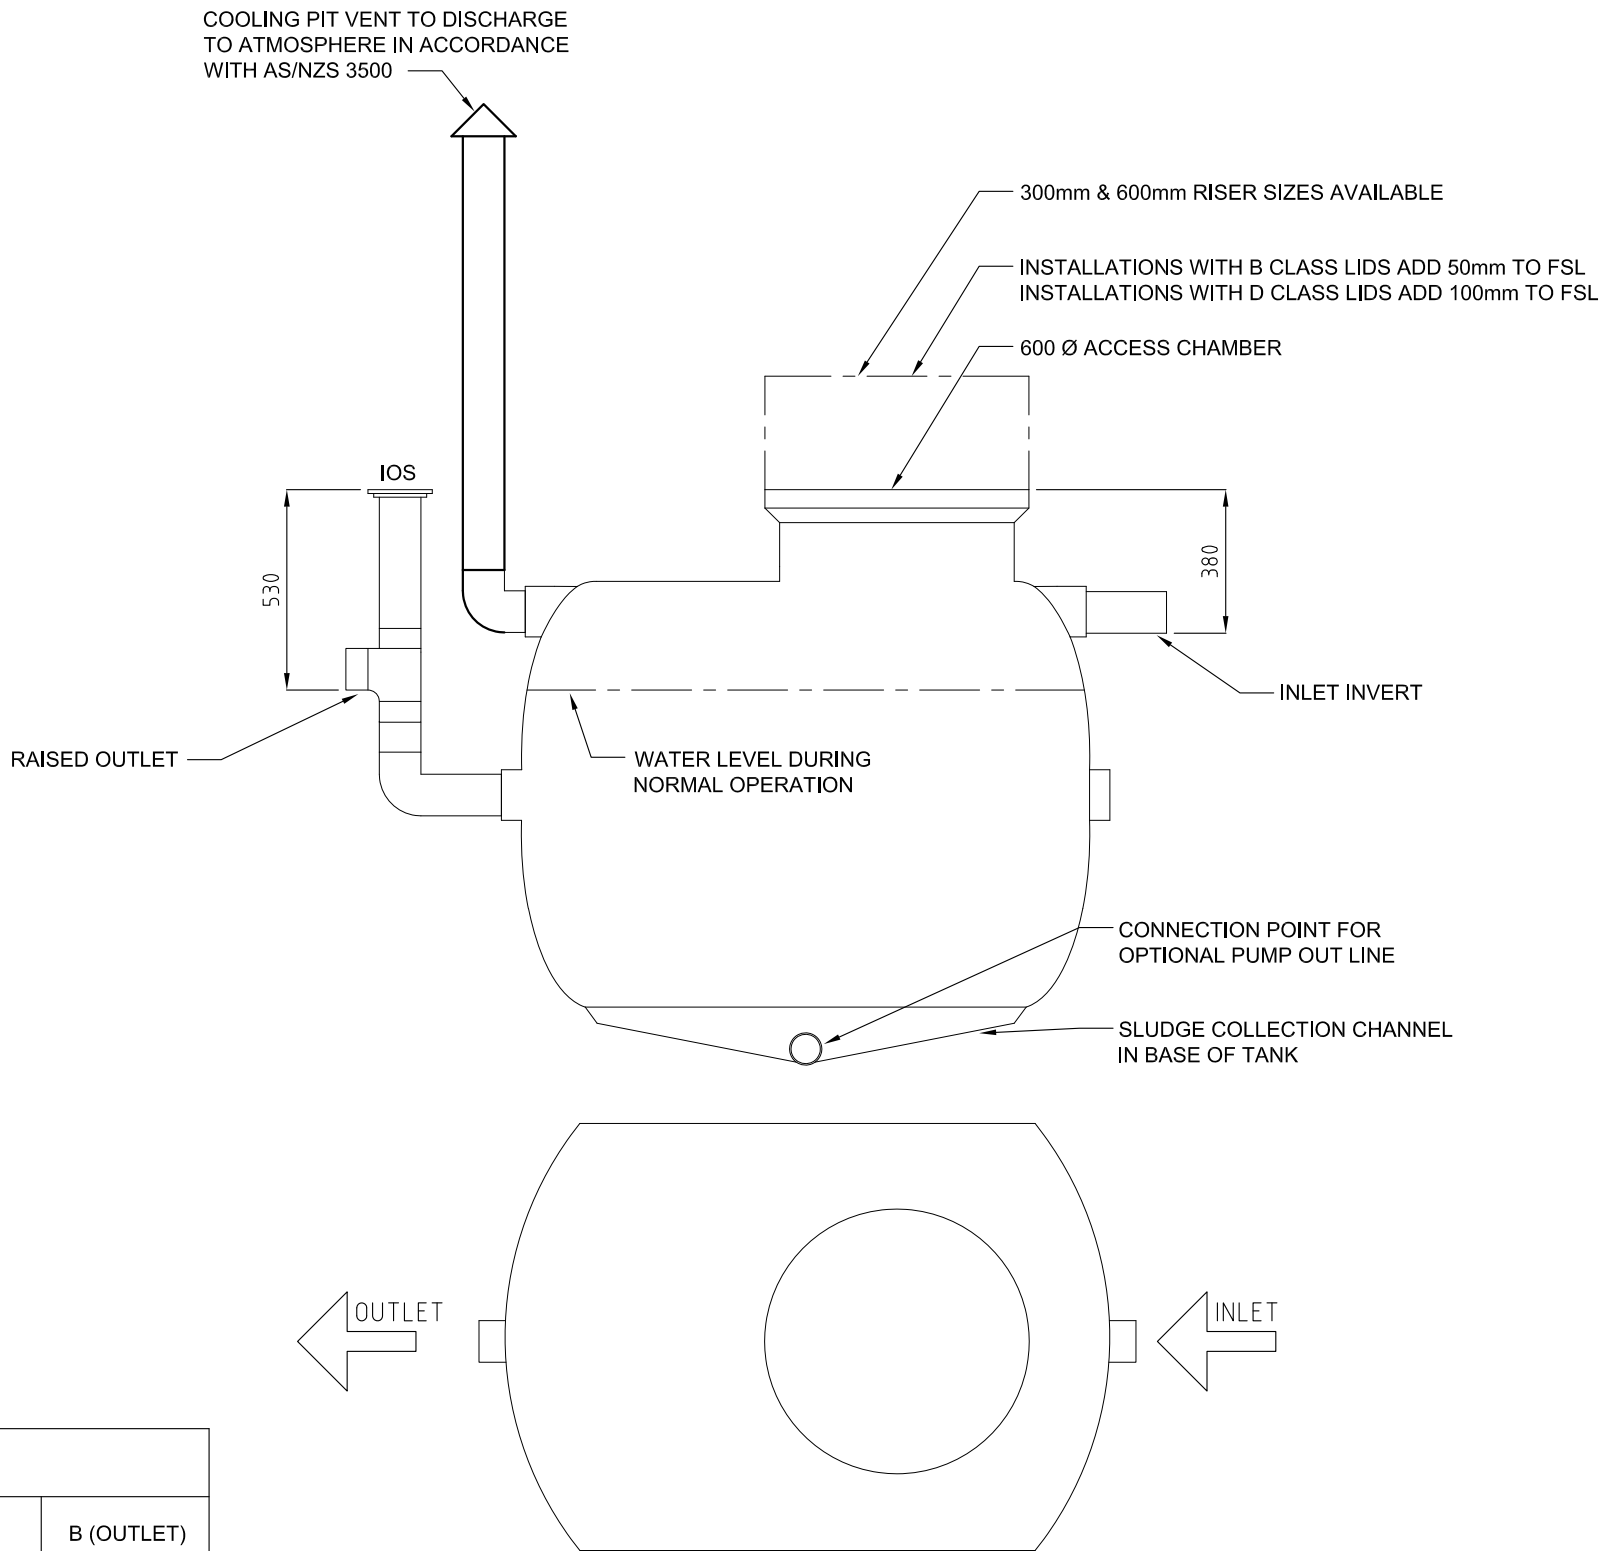

HALGAN HCPS DIMENSIONS

MODEL	HEIGHT	WIDTH	LENGTH	VOLUME	WEIGHT	A (INLET)	B (OUTLET)
HCPS 1000	1515mm	1130mm	1600mm	1000 L	90KG	380mm	530mm

THIS DRAWING AND THE INFORMATION CONTAINED HEREON ARE THE PROPERTY OF HALGAN PTY LTD AND MUST NOT BE COPIED, REPRODUCED OR USED WITHOUT THE WRITTEN PERMISSION OF HALGAN PTY LTD.						DO NOT SCALE IF IN DOUBT ASK		3rd ANGLE	REF. DWG.	TITLE	X X X X X	<table border="1" style="width: 100%;"> <tr> <td style="font-size: x-small;">DRAWN</td> <td style="font-size: x-small;">DN</td> <td style="font-size: x-small;">DATE</td> <td style="font-size: x-small;">29.10.2012</td> </tr> <tr> <td style="font-size: x-small;">CHECKED</td> <td style="font-size: x-small;">SM</td> <td style="font-size: x-small;">SCALE</td> <td style="font-size: x-small;">1:20</td> </tr> <tr> <td style="font-size: x-small;">DWG. NO.</td> <td colspan="2" style="font-size: x-small;">HCPS1000</td> <td style="font-size: x-small;">REV.</td> </tr> <tr> <td colspan="3"></td> <td style="font-size: x-small;">A</td> </tr> </table>	DRAWN	DN	DATE	29.10.2012	CHECKED	SM	SCALE	1:20	DWG. NO.	HCPS1000		REV.				A
DRAWN	DN	DATE	29.10.2012																									
CHECKED	SM	SCALE	1:20																									
DWG. NO.	HCPS1000		REV.																									
			A																									
A	29.10.2012	DETAIL DESIGN	DN	SM	KH																							
REV	DATE	DESCRIPTION	BY	CHKD	APP																							

HALGAN 1000 LITRE S SERIES COOLING PIT DETAIL