



HALGAN MGTA 4000 ABOVE GROUND

1. General

- 1.1. Tank constructed from Polyethylene.
- 1.2. Is to be installed in a location that will not cause a nuisance, obstruct fire access, cannot be vandalised or be damaged by vehicles.
- 1.3. Must have ease of access to pumpout point for maintenance.
- 1.4. Non standard installations require Halgan approval.

2. Installation above ground

- 2.1. The Halgan Tanks to be supported on a 100mm thick concrete pad.
- 2.2. Any maintenance platform must be installed in accordance with Australian Standard 1657-1992 allowing safe access while inspecting and maintaining.
- 2.3. All pipes connecting shall be fully supported; there shall be no stress on the tank connections.
- 2.4. All stormwater must be diverted away to prevent undermining of foundation.

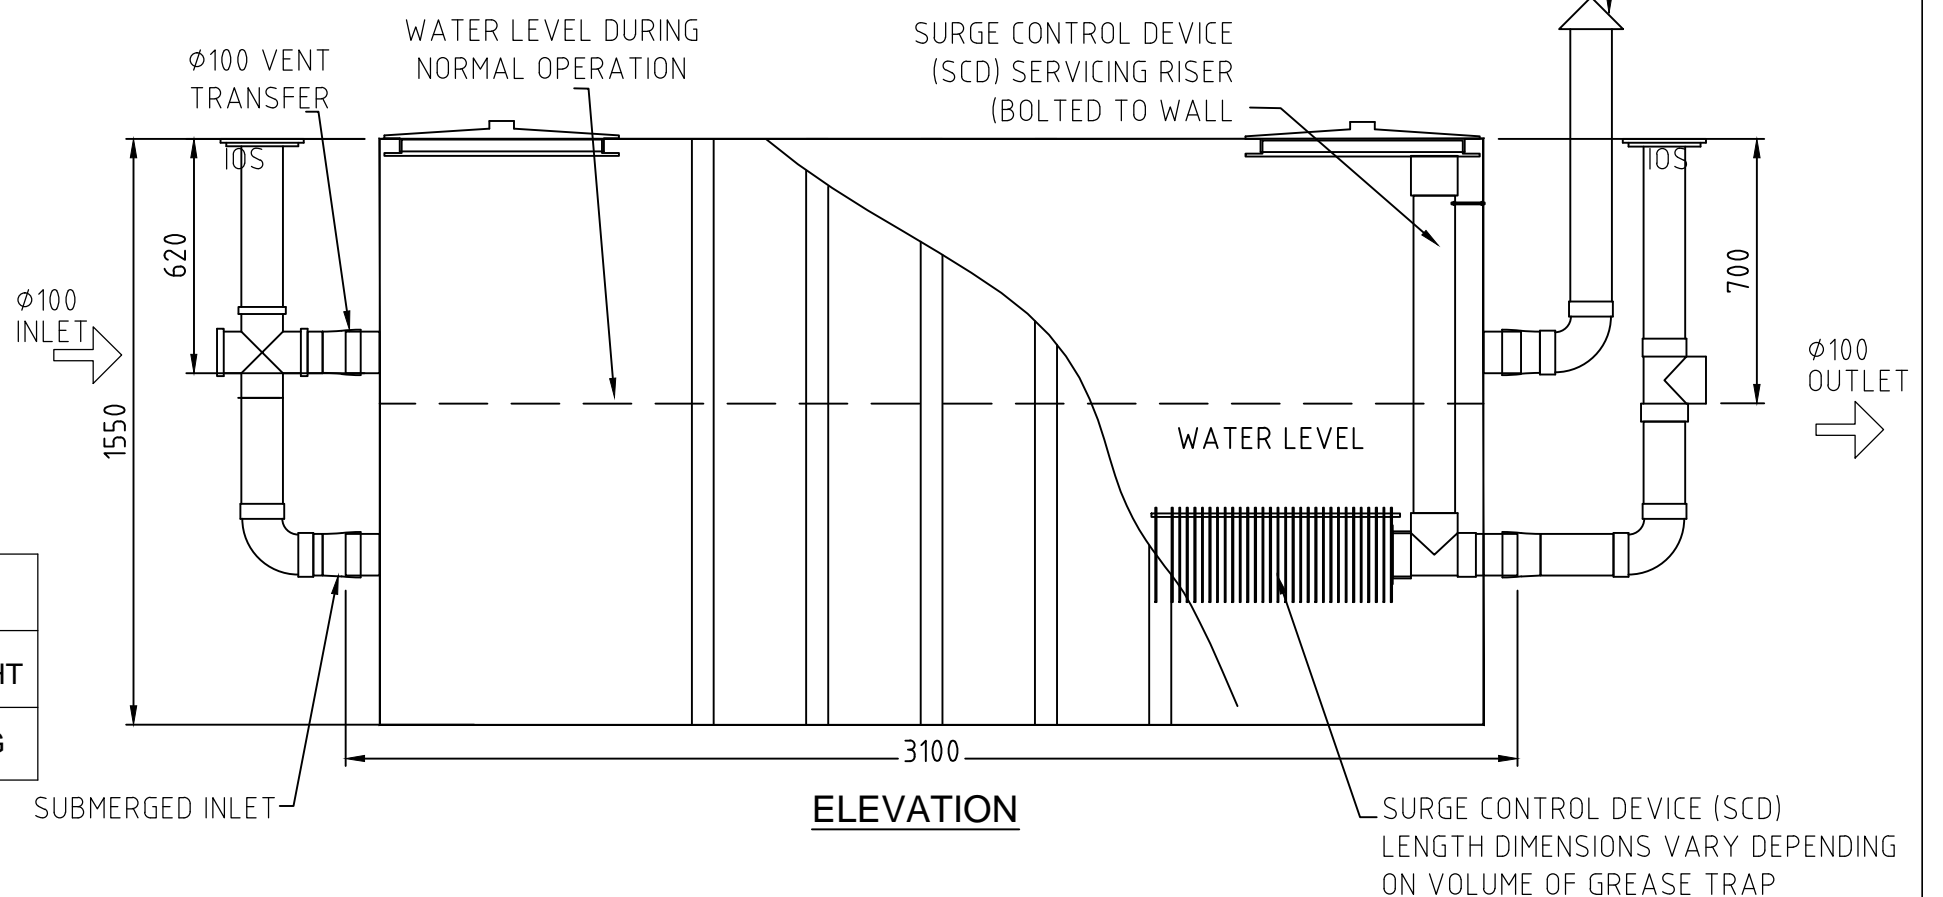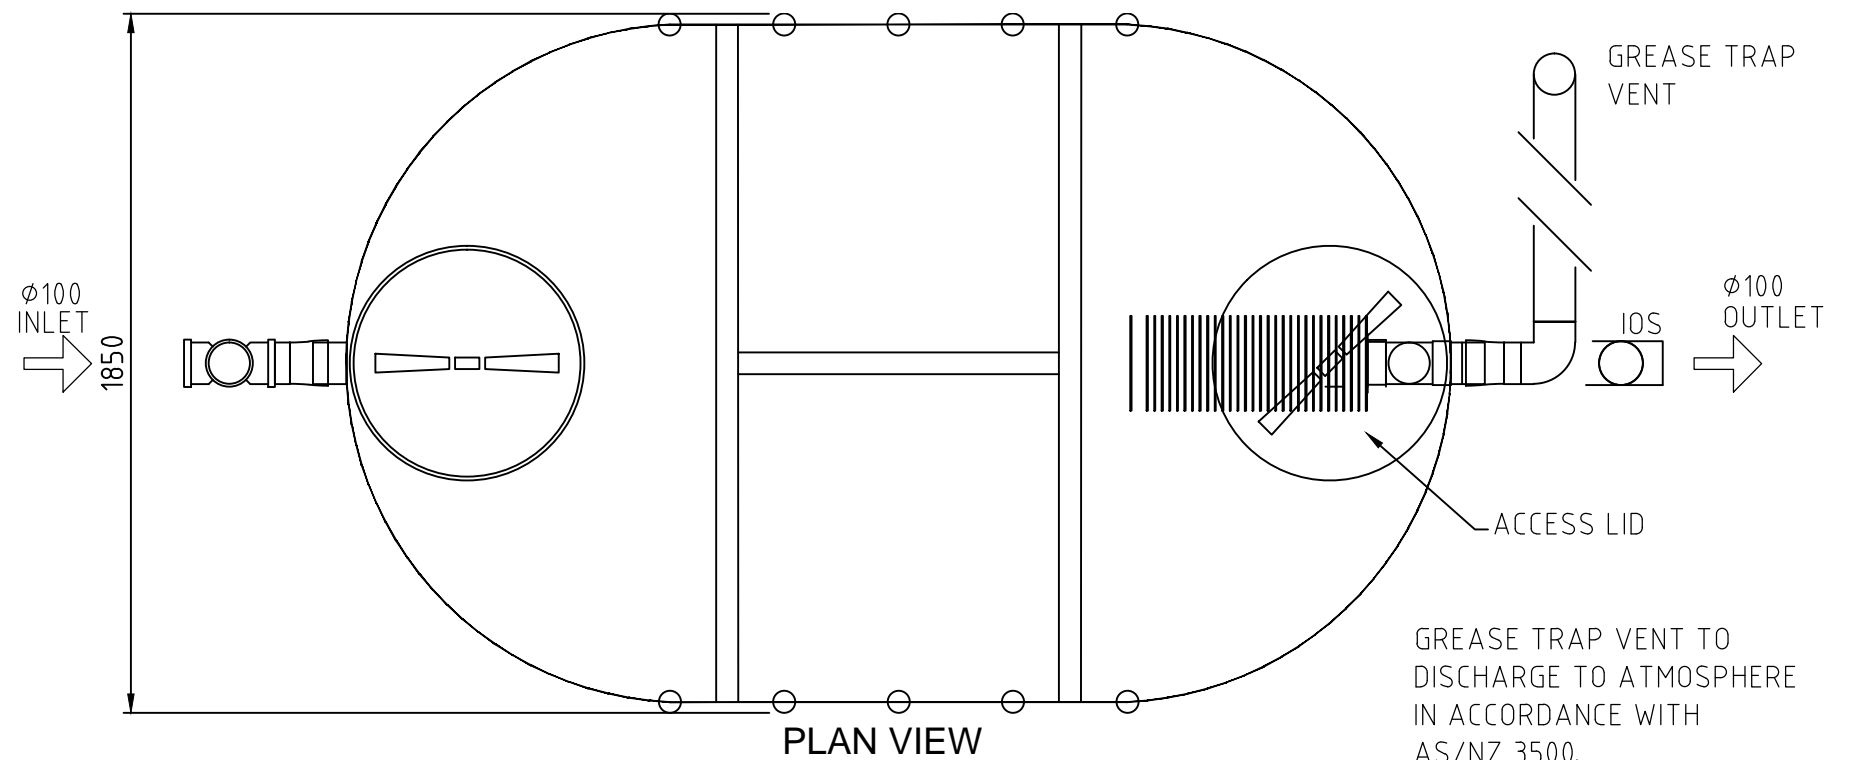

HALGAN MGTA 4000 ABOVE GROUND

MODEL	HEIGHT	WIDTH	LENGTH	VOLUME	WEIGHT
MGTA4000	1550mm	1850mm	3100mm	4000 L	260 KG

REV	DATE	DESCRIPTION	BY	CHKD	APP
A	02-06-2014	DETAIL DESIGN	NM	SM	KH

THIS DRAWING AND THE INFORMATION CONTAINED HEREON ARE THE PROPERTY OF HALGAN PTY LTD AND MUST NOT BE COPIED, REPRODUCED OR USED WITHOUT THE WRITTEN PERMISSION OF HALGAN PTY LTD.

DO NOT SCALE IF IN DOUBT ASK



Freecall 1800 626 753
 PO Box 255
 Collaroy NSW 2097
 admin@halgan.com.au
 www.halgan.com.au



HALGAN MGTA 4000 LITRE
 ABOVE GROUND

DRAWN	DATE	SCALE	REV.
KB	02-06-2014	-	A3
CHECKED			
KH			
DWG NO.			
MGTA 4000			A